

theralux™

ADVANCED MINERAL POOL SYSTEM

Water Management System

User Manual



Contact Us

Theralux Head Office

12 Gatwood Close
Padstow NSW 2211
Australia

T +61 2 9774 5550
E sales@interquad.com.au

Theralux Distributors

Victoria: Aquachem
T +61 3 9792 0088
W www.aquachem.com.au
E admin@aquachem.com.au

Queensland: Aquatic Elements
T +61 7 5534 3136
W www.aquaticelements.com.au
E admin@aquaticelements.com.au

Contents

Manufacturers' Warranty	1
Introducing the Theralux Water Management System	3
How it Works	4
Initial Pool Balance	5
Basic Requirements – the Pool Owner	6
Installation Guide & Diagrams	6
Front Panel	12
Navigating the Menu System	13
Timer Menu	14
ORP Menu	16
pH Menu	18
Status Indicator, Warnings and Safety Shutdowns	19
Maintenance	21
Troubleshooting	22
Mounting Template	23

IMPORTANT

If the power cord is damaged the unit must be returned to Theralux Advanced Mineral Pool Systems for repair.

Always read the instructions and warnings on chemical containers before using chemicals.

Serial Number.....

Date of Installation.....

Installed by.....



Manufacturer's Warranty

Theralux Manufacturer's Warranty

Theralux products come with guarantees that cannot be excluded under the Australian Consumer Law. You are entitled to a replacement or refund for a major failure and for compensation for any other loss or damage. You are also entitled to have the goods repaired or replaced if the goods fail to be of acceptable quality and the failure does not amount to a major failure. The benefits under this warranty are in addition to other rights and remedies under a law in relation to the goods.

3 Year Warranty on New Domestic Installations

Theralux warrants all its products used in new domestic installations to be free from defects in material and/or workmanship for a period of 3 years from the original date of purchase or installation.

2 Year Warranty on Replacement Parts

Theralux warrants replacement parts used in domestic installations, including multi-electrodes (probes), solenoid valves and electrolytic cells (but excluding wearing parts such as tubing and squeeze tubing) to be free from defects in material and/or workmanship for a period of 2 years following purchase.

Exclusion for Wearing Parts

This warranty does not extend to wearing parts, in particular the squeeze tubes fitted in dosing pumps. Squeeze tubes should be replaced every **six months** by a suitably qualified technician. Theralux Advanced Mineral Pool Systems is not liable for any failure of its products or other damage caused by failure of a squeeze tube that has been used for more than six months.

WARRANTY OBLIGATIONS OF THERALUX ADVANCED POOL SYSTEMS

If a defect in workmanship or materials in any Theralux product covered by this warranty is discovered during the term of the warranty, and provided the warranty holder follows the procedure set out below, Theralux will repair or replace **that item** at the option of the warranty holder.

PROCEDURE FOR CLAIMING UNDER THIS WARRANTY

In order to claim under this warranty, the warranty holder must:

- Contact Theralux Advanced Pool Systems as soon as possible after the discovery of the defect and in any event, within the relevant warranty period;
- Confirm date of installation;
- Confirm that the installation was completed by a suitably qualified technician, as set out in the installation manual; and
- If required, arrange for the relevant Theralux product to be returned to Theralux Advanced Pool Systems for repair, and the warranty holder is responsible for the cost and risk of any freight or transportation to and from Theralux Advanced Pool Systems.

CALL OUT FEES

- This is a “Back to Base” Warranty, which means that if the Theralux product needs to be serviced, replaced or repaired at a place other than Theralux Advanced Pool Systems’ premises, a call out fee will be charged to cover the cost of travel by an authorised Theralux technician. Please note that this call out fee will NOT be charged when the relevant Theralux product is returned to Theralux Advanced Pool Systems for repair.
- If an authorised Theralux technician repairs or replaces a Theralux Product and this warranty does NOT apply, a fee for labour and parts supplied will be charged in addition to the call out fee.
- If the Theralux product needs to be returned for repairs under this warranty, the warranty holder is responsible for the cost and risk of any freight or transportation to and from Theralux Advanced Mineral Pool Systems.

WARRANTY EXCLUSIONS

- This warranty is for domestic installations only. Where Theralux Advanced Mineral Pool Systems products are installed for a commercial application this warranty does not apply.
- This warranty extends to the original owner only, beginning on the date of installation and is not enforceable by any other party without the prior written consent of Theralux Advanced Mineral Pool Systems.
- Theralux Advanced Mineral Pool Systems is not responsible for any cost of freight or transportation to or from its Service Department.
- Theralux Advanced Mineral Pool Systems is not liable under this warranty if the installation of the Theralux product was not carried out by a suitably qualified technician.
- To the extent permitted by law, Theralux Advanced Mineral Pool Systems is not liable for:
 - any incidental or consequential loss incurred in connection with the removal or replacement of the Theralux product under this warranty; or
 - Product failure resulting from misuse, freezing, accident, negligence, improper installation or inadequate maintenance.
- To the extent permitted by law, Theralux Advanced Mineral Pool Systems disclaims all other warranties, either express or implied, including, but not limited to, implied warranties of merchantability and fitness for a particular purpose with regard to Theralux Advanced Mineral Pool Systems products, parts and/or any accompanying written materials.

CONTACT THERALUX ADVANCED MINERAL POOL SYSTEMS

- 12 Gatwood Close, Padstow, NSW Australia.
- T +61 2 9774 5550
- E sales@interquad.com.au

Introducing the Theralux Water Management System

What's in the box?

- Multi-electrode (probe)
- Theralux – Water Management System and Mains Cable
- Tubing
- User Manual
- Injection manifold
- Mounting hardware (raw plugs, screws and paper template)

Operation Following a Power Failure

The Water Management System comes with a timer function built into the operating software. The timer is a 24-hour type with quartz-crystal control. This Timer is backed-up by a Real-Time Clock (RTC) similar to those found in computers.

During a power failure the Water Management System will keep time and maintain AutoMode functions.

If a Filter Cycle is active when power is returned the pump will be turned ON within 1 minute. The Water Management System will keep all its settings and will not need to be re-programmed.

The Water Management System is ideal for use in systems where repeated power cuts occur, such as off-peak power circuits and Queensland's Tarriff33 system.

How it works:

The Water Management System is used to control a Salt Water Chlorinator.

Note: the filter system should always be running when the pool is being used.

Oxidation Reduction Potential

The Water Management System measures how much chlorine is in pool water by measuring the ORP of the water.

ORP stands for Oxidation Reduction Potential. Chemicals like chlorine destroy pathogens (eg harmful bacteria) in water by oxidising them.

The level of oxidation available in the water can be measured chemically with an ORP sensor contained in the Water Management Systems multielectrode (probe). This produces a voltage related to the ORP of the water, which is a measure of the effectiveness of chlorine in the water.

Varying the ORP will affect how long it takes to destroy harmful bacteria in pool water. For example, if ORP is maintained at 650mV, E-coli type bacteria will be destroyed in around one second. However, if the ORP is lowered to 550mV, the same organisms may take up to 2 hours to be eliminated.

pH Control

When chlorine is added to water the pH always changes – this is because chlorine is not a neutral chemical. The pH will slowly rise as chlorine is added to the water. A rise in pH greatly reduces the effectiveness of the chlorine as a sanitiser, so it is important to ensure that the pH remains in the correct range.

The pH of the water can be lowered by the addition of acid – and your Water Management System does this automatically. The Water Management System's multielectrode (probe) measures the pH of the water and doses the pool with small amounts of acid to keep the pH in the correct range.

Initial pool balance

Before you begin using the Theralux Water Management System make sure your pool water is balanced as follows:

Chlorine

If it is a new installation, add enough chlorine (liquid or granular) to achieve a reading of 3ppm on an appropriate test kit.

Stabiliser

If the pool is outdoors, it is vital that stabiliser (also known as cyanurate and cyanuric acid) be added and maintained at 40ppm to 60ppm. This compound reduces chlorine destruction due to sunlight. However, too much stabiliser will reduce the effectiveness of chlorine and can result in poor quality water so ensure stabiliser does not exceed 80ppm.

Good stabiliser level keeps good chlorine levels and reduces maintenance.

pH

For chlorine to be effective, the pH must be within a certain range. This is usually between 6.8 (fibreglass/liner pools) or 7.2 (concrete/plaster) and 7.8.

Adjust pH down with acid – powder, liquid sulphuric or liquid hydrochloric. Be very careful with acid as it can be harmful and corrosive.

Total Alkalinity (TA)

Total alkalinity is also known as carbonate hardness or TA for short. The recommended level is between 80 and 120ppm.

TA is related to pH in that it stops the pH from varying quickly with small additions of acidic or alkaline chemicals. When the TA is low it is almost impossible to control the pH.

To raise the TA, buffer (sodium bicarbonate) is added. This must be done slowly as buffer will also cause the pH to rise. As an approximate rule every increase of 20ppm of TA will also cause a 0.1 rise in pH. Once buffer is added it should be left to mix in the pool for a few hours before reducing the pH.

Phosphates and Nitrates

Phosphate and ammonia nitrogen will make your garden green – and they will do the same thing to your pool. Check for phosphates and add phosphate remover if necessary. Don't let fertiliser get into your pool! Phosphates are also in some cleaning products – check the label if using around your pool.

Controlling a Mineral/Salt Water Chlorinator

Follow the directions for the initial balance for your SWC unit – the difference is likely to only be the addition of salt or minerals. Note that the Water Management System unit will turn the power to the SWC unit on and off – the SWC unit must be capable of functioning in this manner and should be set to manual operation only (not automatic).

Basic Requirements – the Pool Owner

Your Theralux Water Management System maintains pool water biological safety by controlling the pH and the ORP (sanitation level). It achieves this by dosing the necessary chemicals into the pool in a controlled manner. The chemical drum must be checked on a regular basis – an empty drum will lead to poor balance and incorrect operation.

To achieve water safety effectively and efficiently there are other water balance factors that must be maintained by the pool owner.

The most important water balance factors are described on the previous page.

Failure to maintain these aspects of pool water balance can lead to poor water quality and incorrect/unusual operation of the Water Management System unit.

In the case of incorrect or unusual operation the pool water must be tested and any balance problems corrected. After this is done it may also be necessary to clean the Probe – this is part of the unit maintenance, see page 21.

IMPORTANT SAFETY MEASURES:

- Always add concentrated chemicals to water – not the other way around!
- Don't allow chemicals to mix – dangerous, highly corrosive fumes will be produced.
- Always wear protective clothing, footwear, gloves and eye protection when handling pool chemicals to avoid injury.
- If a spill occurs, wash the affected area with fresh water immediately and seek medical attention.
- Work in a well ventilated area and avoid inhalation of fumes.
- Read and follow safety instructions on chemical drums.


Installation Guide

Choosing a good location

The Water Management System is manufactured from weather resistant materials and is designed for operation in full sun and rain. However, your Water Management System will benefit if it is protected from the weather. The Water Management System Power Supply should not be mounted close to where chemicals are stored (eg acid and chlorine) as vapours from these chemicals are corrosive and may damage the electronic controls within the unit.

Insect intrusion (particularly ants) can cause problems with all equipment. Ensure that the pool equipment area is kept free of insects as much as possible. Insect intrusion is not covered under the warranty.

INSTALLATION DIAGRAM - DOSING PUMP MODULE

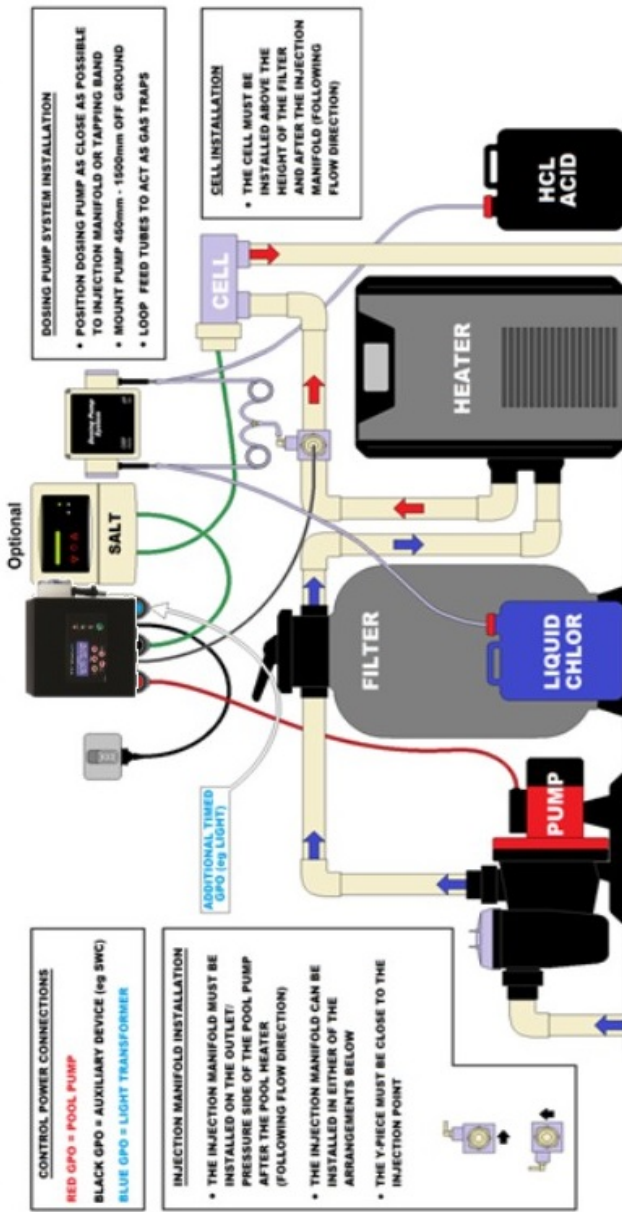

Installing the Theralux Water Management System

Locate the Water Management System Controller close to the filtration pump so that it may be connected easily. Connect the Water Management System Controller to the mains power outlet of the pool area and make sure this outlet meets all applicable Australian Standards at the time of installation.

Mount the Water Management System Controller at least 1.5m above the ground and at least 3m from the pool water. A mounting template has been provided (last page of manual) that shows you where to place screws on either a wall or post.

The PUMP socket outlet in the base of the Water Management Systems Power Supply is dedicated to the filtration pump only. Do not use a double adaptor to connect another pump as this will overload the system and void warranty.

Your Water Management System has two other power outlets on its base, which can be used to run lighting or an SWC unit (or other pool equipment). These outlets are also timed, so accessories can be set to turn on and off automatically.

Installing the Injection Manifold

Ensure that the suction line has no air leaks. The pump suction must be between -20kPa and -70kPa. Turn off the pool pump before installing the injection manifold.

The injection manifold should be installed on the return (pressure) side of the pump, after any accessories such as heaters. **Make sure it is installed close to the manifold and that the gas loop is vertical as this will trap any gas from chemical mixing.**

Installing the Probe into the Injection Manifold

The probe has a bayonet fitting. To install the probe, simply insert it into the injection manifold and twist to lock the bayonet fitting. Ensure that the o-ring seal is not twisted or out of place.

Acid drum

Position the acid drum in a safe and secure location, preferably about 2 metres from the Water Management System. Ensure you have the right chemicals for your pool and that the acid has been diluted if necessary (See page 6 for safe chemical handling).

Installing the Dose Pump – Outlet Side

Cut a length of tubing that will reach from the base of the dose pump to the injection manifold tubing. Connect one end of the tubing to the outlet side of the dose pump (the direction of flow is indicated by an arrow on the front cover of the pump.) Connect the other end of the tube to the loop near the injection manifold. **Make sure the gas loop is vertical as this will trap any gas from chemical mixing.**

Cut another length of tubing that will reach from the base of the dose pump to the base of the acid drum. Position the acid drum in a safe and secure location, preferably about 2 metres from the Water Management System.

Connect the one end of this tube to the inlet side of the dose pump (the direction of flow is indicated by an arrow on the front cover of each dose pump.)

Drill an 8mm hole in the lids of the acid drum and pass the tubing through the hole in the drum lid. Place a sinker on to the end of the tubing that will be in the drum and then attach the drum filter. Note that the drum filter incorporates a non-return valve to prevent back-flow into the chemical drum.

Before placing the tubing into the drum, measure the tubing against the outside of the drum and wrap several turns of PVC tape around the tubing above the drum lid so that the drum filter will be 10-15mm above the bottom of the drum. Lower the drum filter and sinker into the drum and screw on the lid.

Installing the Suction Tubing to the Acid drum

Cut a length of tubing that will reach from the base of the dose pump to the base of the acid drum. Make sure the acid drum is in a safe and secure location, preferably about 2 metres from the Water Management System.


Connect one end of a tube to the inlet side of the dose pump (the direction of flow is indicated by an arrow on a label or the front cover of each dose pump.)

Drill an 8mm hole in the lid of the acid drum and pass the tubing through the hole in the drum lid. Place a sinker on to the end of the tubing that will be in the drum and then attach the drum filter. Note that the drum filter incorporates a non-return valve to prevent back-flow into the acid drum.

Before placing the tubing into the drum, measure the tubing against the outside of the drum and wrap several turns of PVC tape around the tubing above the drum lid so that the drum filter will be 10-15mm above the bottom of the drum. Lower the drum filter and sinker into the drum and screw on the lid.

The Theralux – Water Management Systems

Front Panel: Operational Buttons

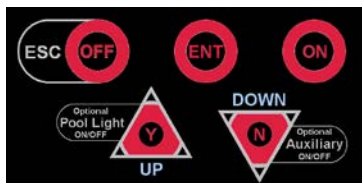

The Water Management System has 5 buttons that allow you to control its functions. Each button is labelled with its primary function. Secondary functions are labelled within an outline next to the button. Buttons are backlit to show activity, with the ESC/OFF button always available to take you back to the home screen.

ON Button

Turn the System On Manually

Press the ON button once to switch the Water Management System and the pool pump on manually. The Water Management System will default back to AUTO and turn itself off automatically at the end of the next programmed FILTER CYCLE (and this time will be displayed on the LCD).

Increasing Manual Run-time in Hourly Increments

Press the ON button repeatedly (or hold the button down) to increase the manual run time in hourly increments. The run time is displayed on the LCD. When the desired run time has been reached, press the ENT button to confirm your selection and the system will commence operation.

ESC/OFF Button

Turn the System Off Manually

If the Water Management System and pool pump are running, pressing this button will turn them off manually. The Water Management System will automatically turn on again at the start of the next FILTER CYCLE (and this will be displayed on the LCD).

Return to Home Screen

If you have unintentionally accessed a Water Management System Menu that you don't actually require, pressing the ESC/OFF button allows you to return to the home screen at any time.

ENT Button

Use this button to enter the Water Management System Menu and to access the various options in each Menu. Use the Y/UP and N/DOWN buttons to scroll through menu options and when your desired menu option is displayed on the LCD, press ENT to access that option.

Y/UP Button and Optional Pool Light

If you have accessed the Water Management System Menu by pressing the ENT button, press the Y/UP button to scroll upwards through the various menu options. Some menu options will prompt a yes or no answer. If you wish to answer "yes", press the Y/UP button.

If your Water Management System also controls your pool lighting (optional), you can turn the lights on or off manually by pressing the Y/UP button. For multi-coloured lights, hold the Y/UP button down to cycle through the various colours and release once the desired colour is reached.

The Water Management System Display

LCD Display

Line 1	15:27	NORMAL	Auto
Line 2	AutoON → AutoOFF@ 21:00		
Line 3	ORP=670mV	SET=650mV	
Line 4	pH= 7.5	SET= 7.6	

The Water Management System uses a four line LCD display to provide the user with information.

READ OPERATION MANUAL FOR DETAILED INSTRUCTIONS

- Line 1 shows the current time and the mode of operation.
In the example above, line 1, tells you that the time is 3:27pm and the Water Management System is operating in “Normal Automatic mode”
Note that the Water Management System displays the time using a 24 hour clock.
- Line 2 shows timer information.
In the example above, line 2 tells you that the “unit is turned ON and will turn OFF automatically at 21:00 (9pm)”
- Line 3 displays ORP (Chlorine) information.
In the example above, line 3 tells you that the current ORP is 670mV with the unit set to provide 650mV
- Line 4 displays pH information.
In the example above, line 4 tells you that the current pH is 7.5 with the unit set to provide 7.6.

Navigating the Water Management Systems Menu

There are three aspects to the general Water Management System Menu – the Timer Menu, the ORP (Chlorine) Menu and the pH Menu. Access the Water Management System Menu by pressing the ENT button and following the prompts on the LCD. If you find you have ended up in a part of the Menu system unintentionally, you can return to the Home Screen by pressing the ESC/OFF button at any time.

Use the Y/UP and N/DOWN buttons to scroll through the various menu options until the desired option is displayed on the LCD. Use the ENT button to confirm that you wish to select that option.

Once accessed, use the Y/UP and N/DOWN buttons to adjust operational settings up or down – and confirm adjustments by pressing ENT. To cancel any adjustments, simply press ESC/OFF to return to the Home Screen.

Advanced Settings Menu

If you are interested in learning more about additional functionality of your Theralux- Water Management System, a detailed **Advanced Settings Manual** is available to download from the Theralux Advanced Mineral Pool Systems website – <https://www.thermalux.com.au> or call Theralux Advanced Mineral Pool Systems on **+61 2 9774 5550** for further information. Some menus in Advanced Settings are:

- POOL – information on pool volume and whether it is concrete or fibreglass
- SYSTEM DATA - shows service information
- FILTER CYCLES - 4 Filter Cycles can be active - useful for seasonal adjustment.
- AUX - controls timed operation of auxiliary power outlet
- FULL MANUAL ON or AUTO TIMER ON – use when the Water Management System is being run as a “slave” to another controller.

Timer Menu

Setting the time

Once you have installed your Water Management System and turned it on, you will need to set the correct time on the Water Management Systems 24 hour clock.

First, access the Menu System by pressing the ENT button.

The LCD will display the word TIMER MENU. Select this by pressing the ENT button once more.

Line 2 on the LCD will now read SET TIME HOURS. Press ENT to select this option and then use the Y/UP and N/DOWN buttons- to adjust the hours on the LCD. Confirm the correct hours value by pressing ENT again.

The LCD will now show SET TIME MINUTES. Adjust the minutes using the Y/UP and N/DOWN buttons. When complete, press ENT to return to normal operation.

ADJUST CYCLES Sub-Menu

Your Water Management System has two filter cycles pre-programmed as factory defaults as follows:

Filter Cycle 1:	ON at 07:00 (7am)	OFF at 10:00 (10am)
Filter Cycle 2:	ON at 18:00 (6pm)	OFF at 21:00 (9pm)

You can change the start and finish times of each filter cycle to meet your sanitiser requirements and to suit your lifestyle.

To adjust filter cycle start and finish times, press ENT to access the Water Management System Menu system. Press ENT again to select the TIMER menu and then scroll down using the N/DOWN button until ADJUST CYCLES is displayed on the LCD.

Select this option by pressing ENT and the LCD will show the start (ON) time of the filter cycle being adjusted. Use the Y/UP and N/DOWN buttons to adjust the start time. Press ENT to confirm your selection and then the LCD will show the end (OFF) time for that filter cycle. Adjust the OFF time in the same way as the ON time and press ENT to confirm.

After ON and OFF times for the first filter cycle have been adjusted, the ON time for the second filter cycle is shown on the LCD. This can be adjusted in the same way, or if you do not wish to make any changes, simply press ENT to confirm the time shown on the LCD. Follow the same process to either adjust or confirm the OFF time for the second filter cycle, and once this has been confirmed the LCD will display the home screen.

Note: an additional 2 filter cycles can be enabled and programmed via the Advanced Settings Menu. For details on how to access this menu, please refer to the Advanced Settings Manual (available to download from <https://www.theralux.com.au>) or call Theralux Advanced Mineral Pool Systems on +61 2 9774 5550.

Running Times

We recommend your system be operated for ***at least 4 hours per day and always run the system when using the pool.***

As sunlight destroys chlorine, it is recommended that the Water Management System be run mostly in the evening.

Chlorine is added for sanitation but the filter is needed to remove pollutant particles (dust, sand etc) and keep the water looking good. The filter must operate for a reasonable number of hours per day to remove pollutants. If there are adverse local conditions – such as windborne dust and debris - the chlorine demand will be higher than normal and you will likely need to operate the system for longer periods to adequately filter the water.

Optional LIGHT Timer Sub-Menu

You can use your Water Management System to turn your pool or garden lighting on and off automatically, you can set the ON and OFF times using the light timer menu.

Press ENT to access the Water Management System Menu system. Press ENT again to select the TIMER menu and then scroll down using the N/DOWN button until LIGHT MENU is displayed on the LCD.

Line 2 on the LCD will now read "AUTO? Y/N". To enable automatic light operation press the Y/UP-button. Line2 will read "Auto ON" for short period before displaying "ON hh:mm".

Adjust the ON time using the Y/UP and N/DOWN-buttons and confirm by pressing ENT. The LCD will now prompt you to set the OFF-time, which is accomplished using the Y/UP and N/DOWN-buttons as before. Press ENT-to confirm the new OFF-time and the LCD will return to the home screen.

To disable automatic light operation, access the LIGHT menu in the way described above and when asked "AUTO? Y/N" - press the N/DOWN button. Line 2 will read "Auto OFF" for short period then the system will return to normal operation and the light can only be operated manually (see below for how to do this).

Manual Light Operation

If the Water Management System is turned on, the light can be turned on or off manually by pressing the Y/UP-button.

If you have multi-coloured LED lights that cycle through different colours and requiring a power pulse to change effects, you can hold down the Y/UP-button to cycle through the options and release when the desired colour or effect is achieved.

ORP (Chlorine Menu)

Accessing the ORP Menu

Access the Water Management System Menu by pressing ENT. Use the Y/UP or N/DOWN button to scroll through the main menu until ORP MENU is displayed on the LCD. Press ENT to select.

Adjusting the Set Point

The ORP Set Point is the value in millivolts that the Water Management System will adjust your pool water to. You can adjust the ORP Set Point via the ORP Menu.

Adjust ORP Control On or Off

To disable the ORP System (or re-enable it if it has been disabled) you need to access the ORP menu and work your way through the MANUAL FEED, SUPER CHLOR and ADJUST SET POINT questions – pressing the N/DOWN button in response to each question.

The LCD will then read "ADJUST ORP CONTROL TURN OFF? Y/N" (if the system is ON) or "ADJUST ORP CONTROL TURN ON? Y/N" (if the system is OFF). If you press Y/UP, the system will turn on (or off depending on its current status). If you answer N/DOWN to either question, the LCD will return to the home screen.

pH Menu

Accessing the pH Menu

Access the Water Management System Menu by pressing ENT. Use the Y/UP or N/DOWN button to scroll through the main menu until pH MENU is displayed on the LCD. Press ENT to select.

Manual Feed

Having accessed the pH menu, the LCD will ask "Manual Feed Y/N?". Press Y/UP to select and the display (on solenoid valve models) will read "FEED 5 Sec/50mL". On dosing pump models the display will read "FEED 5 mins/75mL"

You can increase the amount of the dose by pressing the Y/UP button until the desired dose amount is displayed. (Note: the dose volume displayed is an estimate only).

Press ENT and (depending on which model you have) either the solenoid valve or the dose pump will commence feeding

Adjusting the Set Point

The pH Set Point is the pH that the Water Management System will adjust your pool water to. You can adjust the pH Set Point via the pH Menu.

Enter the pH Menu as described above, and press the N/DOWN button when asked whether you wish to do a manual feed. The LCD will then read "ADJUST SET POINT Y/N?" Press Y/UP to select this option and then the LCD will display the current set point. Adjust this using the Y/UP or N/DOWN buttons. Confirm the adjusted set point by pressing ENT. The new set point will then be displayed on the right hand side of line 3 of the LCD.

Calibration and Re-setting Factory Defaults

If your Water Management System consistently displays a pH reading different from that obtained by manual testing with a quality test kit, it may be necessary to re-calibrate the multi-electrode (probe). The instructions below assume the probe is measuring a pH of 7.8.

Caution: do NOT re-calibrate the probe until identical pH readings have been obtained from at least three tests from around the pool. You will need to calibrate the probe to the pH value obtained from these test kit results.

Enter the pH menu as described previously and press the N/DOWN button when asked whether you want to do a manual feed, and then again when asked whether you wish to adjust the set point.

The LCD will then read “CALIBRATE PROBE?”. Press Y/UP to select this option and the LCD will read “PROBE Ph = 7.8 ADJUST TO +0.0”. Use the Y/UP button to increase the adjusted value to the required level. Press ENT to confirm the adjustment and after a few seconds the Water Management System will revert to normal operation and the home screen will display the new pH value.

Adjust pH System On or Off

To disable the pH System (or re-enable it if it has been disabled) you need to access the pH menu and work your way through the MANUAL FEED, ADJUST SET POINT and CALIBRATE PROBE questions – pressing the N/DOWN button in response to each question.

The LCD will then read “ADJUST pH CONTROL TURN OFF? Y/N” (if the system is ON) or “ADJUST pH CONTROL TURN ON? Y/N” (if the system is OFF). If you press Y/UP, the system will turn on (or off depending on its current status). If you answer N/DOWN to either question, the LCD will return to the home screen.

Note: Turning off the supply of acid is not normally necessary and could lead to unbalanced pool water that is unsafe to swim in. Theralux Advanced Mineral Pool Systems recommends that you seek advice from a qualified professional prior to disabling the pH system – or call Theralux Advanced Mineral Pool Systems on +61 2 9774 5550.

Water Management System Status Indicators, Warnings and Safety Features

Normal Operation – Green Status Indicators

When the Water Management System is operating normally and ORP and pH readings are within the correct range, a green status indicator will be illuminated and the LCD will indicate the readings.

Note: it is the pool owner’s responsibility to monitor the pool and periodically confirm the Water Management System readings with a good quality test kit. Remember that the Water Management System is only able to balance pH and

Chlorine levels – but you need to ensure other factors such as stabiliser levels and total alkalinity are within the correct range (see page 6 for details).

Low Chlorine

If the ORP falls significantly below the set point, this indicates that the chlorine levels in the pool have fallen and dangerous pathogens in the water are not being destroyed rapidly.

The Water Management System will warn of low chlorine with a red status indicator and the word “low” will be displayed on the ORP line (line 3) of the LCD.

Possible causes include:

- An empty chlorine drum
- Faulty solenoid valve or dose pump
- Low levels of stabiliser
- High pH
- Filter requires backwashing
- The multi-electrode (probe) may require cleaning (see page 24 for details)

If each of these factors is addressed, the Water Management System will dose the pool with chlorine until the set level is achieved – at which point the status indicator will revert to green and the warning will no longer be displayed on the LCD.

High Chlorine

If the ORP rises significantly above the set point, a red status indicator will be illuminated and the word “High” will appear on the ORP line (line 3) of the LCD.

Possible causes include:

- Manual overdosing (superchlorination)
- Faulty solenoid valve or dose pump
- The multi-electrode (probe) may require cleaning (see page 24 for details)
- Low pH (too much pool acid)
- High Total Dissolved Solids (TDS)

There is no simple way to reduce high chlorine levels quickly. However, chlorine levels will eventually reduce over days (or weeks), particularly if the pool is exposed to sunlight.

Low pH – (Excess Acid)

If the pH of the water drops below the set point, a red status indicator will be illuminated and the words “LOW pH” will be displayed on the LCD.

The Water Management System will automatically prevent any further acid being added to the pool until the pH is brought back into the correct range by the addition of sodium carbonate or sodium bicarbonate.

Possible causes include:

- Manual overdosing
- Excessive rainfall
- Faulty solenoid valve or dose pump
- The multi-electrode (probe) may require cleaning (see page 24 for details)
- Low Total Alkalinity
- Poor pool water circulation

Safety Shutdown

If the pH falls below 5.8 the Water Management System will shut down pump operation to ensure no more acid gets into the pool.

High pH – (Insufficient Acid)

If the pH rises significantly higher than the set point, a red status indicator will be illuminated and the words HIGH pH will be displayed on the LCD.

Note that a high pH can drastically reduce the ORP of the pool water, and therefore reduce the effectiveness of the sanitiser. It is important to restore the pH balance as soon as possible by adding acid to the pool.

Possible causes include:

- The acid drum is empty
- The pool has been superchlorinated recently
- The pool has a new plaster lining (very alkaline) demanding more acid than can be supplied by the Water Management System
- Faulty solenoid valve
- Filter requires backwashing
- Multi-electrode (probe) may require cleaning (see page 24 for details)
- Injector nozzle is blocked
- Venturi system (if fitted) is blocked

If each of these factors is addressed, the Water Management System will dose the pool with acid until the set level is achieved – at which point the status indicator will revert to green and the warning will no longer be shown on the LCD.

Maintenance

Like all equipment the Water Management System will look better and last longer if it is maintained and operated in accordance with these instructions.

The Water Management System Power Supply

The Power Supply has been design for operation in full sun and weather. However, it will benefit from being under cover. There is little maintenance required however – some Do's and Don'ts –

Don't:

- Install it in a small sealed enclosure (so it does not overheat)
- Install it in a very hot unventilated shed (so it does not overheat)
- Allow insects to nest in the unit (because they will prevent it from functioning)
- Install chemical drums under or close to the unit (to prevent corrosion)
- Forget about the unit once installed – it should be checked regularly to ensure that it is working for you

Do:

- Install it as per the instructions
- Check it regularly
- Make sure the pool balance is checked regularly

Cleaning the Multi-electrode (Probe)

If the Water Management System is consistently giving readings different from those obtained from a test kit, it may be necessary to clean the multi-electrode.

To do this:

- Remove the probe from the injection point by twisting the bayonet (or if fitted with a tapping band, by unscrewing the retaining nut) and remove the o-ring.
- Holding the cable, gently swirl the probe in a dilute solution of hydrochloric acid (pool acid) for two minutes
- Rinse the probe in clean water and then replace it in the injection point, making sure that the “o-ring” is in place.
- Twist bayonet to lock (or tighten nut with fingers)

Trouble-shooting

Before requesting service, you may wish to run through the check list below but feel free to call Theralux Advanced Mineral Pool Systems on +61 2 9774 5550

If there appears to be low or no Chlorine Residual:

1. Check stabiliser level is 40ppm – 60ppm. Add if necessary and wait for it to dissolve.
2. Have you added any chemical additives recently?
3. Check pool for phosphates and remove if necessary
4. Is the unit turned on and operating the filter pump?
5. If the unit is not running at all, check the fuse in the bottom of the unit.

